


Operating Instruction  
In-line Detonation Flame Arrester 1022-0011  
(Suitable for short time burning)

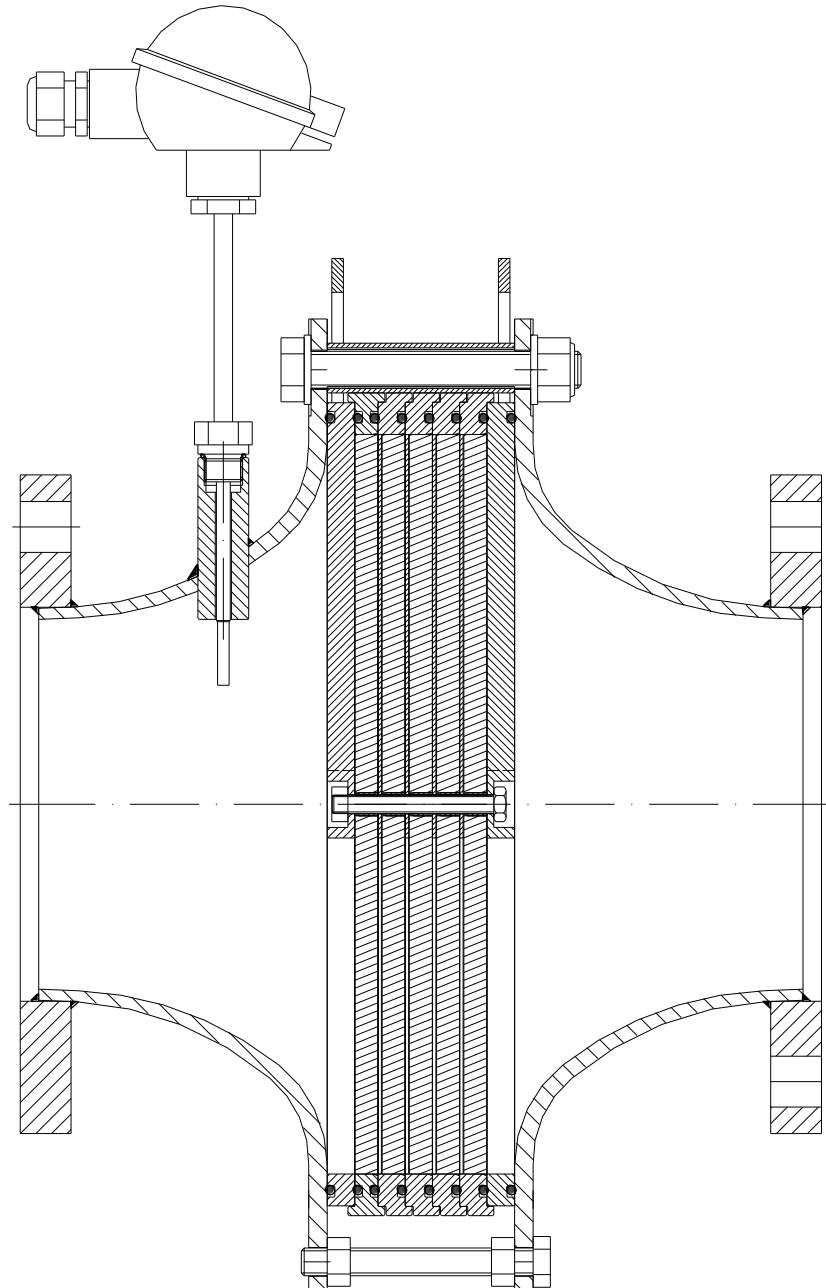

IBExU 13 ATEX 2037 X

 G IIB3

 <sup>0102</sup>

## 1. Preface

This operating instruction apply to in-line detonation flame arrester 1022-0011, provided the fact that your in-line detonation flame arrester meets all technical standards described in this document.

Any information required for the assembly, use and maintenance of the protective system may be obtained from these instructions.

Please read the operating instructions on hand carefully to ensure the safe use of this in-line detonation flame arrester.

All assembly and maintenance work needs to be carried out by qualified staff.

Information provided in this document may be subject to change without prior notice. This document or individual parts of it may not be multiplied or copied without the written consent of Flammer GmbH, irrespective of its purpose.

© 2019 by Flammer GmbH. All rights reserved.

The trade and/or used name designations, trademarks, etc., even when not specially marked, do not justify the assumption that they may be considered as fair use, as defined by trademark protection laws.

The operating instruction on hand corresponds to the current technical state of in-line detonation flame arrester 1022-0011. Content is subject to change. Errors excepted.

In case of dispute, the German text shall prevail.

## 2. Symbols



Take note of the accompanying documents!  
Important instructions for safe usage

## 3. Safety regulations and safety instructions

### 3.1 Safety regulations

The following regulations and guidelines are to be observed for the use of this protective system:

- EC type examination number IBExU 13 ATEX 2037 X
- EN ISO 16852 Flame arresters
- European Directive 2014/34/EU
- National safety regulations
- National workers' protection regulations

### 3.2 Safety instructions

The following instructions are to be observed to guarantee workers protection and occupational safety:

- Safety regulations in compliance with section 3.1
- Observation of laws and provisions in force at the place of application.  
Operators and supervising staff are responsible for the fact that these provisions are observed.
- Assembly and maintenance work is to be carried out by qualified staff.

#### 4. Purpose of use

In-line detonation flame arrester type 1022-0011 prevents light-back at deflagration and stable detonation of potentially explosive vapour-air, and or gas-air mixtures of explosives group IIA1, IIA, IIB1, IIB2 or IIB3 at an absolute working pressure of  $p_{abs} \leq 1.20$  bar in an ignition source preceding pipe with a maximum nominal diameter of  $DN = 150$  mm.

For detection of a stabilized flame a PT100 temperature sensor mounted on the unprotected side as described in chapter 6 is necessary!

When a stabilized flame is detected an action within 30 seconds has to be carried out which ensures a safe quenching of the flame. (E.g. stopping the gas flow)



#### Warning!

**Flame arresters are limited in mounting and use.**

**Pay attention to the following hints according to EN ISO 16852**

Type	DET 4		In-line detonation flame arrester for stable detonation without restriction
Lu/D	n/a		Pipe length not limited
BC	b		Suitable for short time burning
EX	G IIB3		Explosion group
To	60	[ °C ]	Maximum operating temperature
p <sub>o</sub>	1.20	[ bar ]	Maximum absolute operating pressure

#### 4.1 Special conditions for safe usage

- Max. nominal pipe diameter DN between the possible ignition source and the in-line detonation flame arrester : 150 mm
- The nominal pipe diameter on the unprotected side shall be no larger than the flame arrester connection.  
The nominal pipe diameter on the protected side shall be no less than the pipe diameter on the unprotected side.
- The in-line detonation flame arrester may only be used, if the materials resist against the mechanical and/or chemical influences under the actual operating conditions, in such a way, that explosion protection is always guaranteed. This applies particularly to the flame arrester elements whose protection against flame transmission may be endangered by corrosion among others.
- Pipe branches and valves on the unprotected side shall be installed as close as possible to the in-line detonation flame arrester.
- The in-line detonation flame arrester is bi-directional, i.e. that it may be connected to either side of the system.
- The in-line detonation flame arrester may be fitted in any position.
- Combustible gases and or liquids produced during operation must pertain to explosives group IIA1, IIA, IIB1, IIB2 or IIB3 with a standard gap (MESG)  $\geq 0.65$  mm.
- The inline deflagration flame arrester is **tested and authorised for short time burning**. For detection of a stabilized flame a PT100 temperature sensor mounted on the unprotected side is necessary. When a flame is detected an action within 30 seconds has to be carried out which ensures a safe quenching of the flame. (E.g. stopping the gas flow)
- The in-line detonation flame arrester is **not tested and authorised for endurance burning and unstable detonation**.
- Shut off valves before and after the flame arrester has to be fully open during normal operation.

## 5. Technical specifications

(See figure 1)

Connection : Flange DN150 EN1092-1 (DIN 2576) PN10(16) or similar  
 Pressure loss : see fig. 2

## 6. Assembly

(See figure 1)

The in-line detonation flame arrester is to be fully joined to the respective connecting parts.



- Note requirements of chapter 4.
- The internal diameters of the connecting parts have to meet the connected pipe size.
- Any connection is to be sufficiently sealed with suitable media resistant sealing and checked for leakage. (Maximum test pressure  $p_e = 12$  bar).
- During actions producing heat (e.g. welding) the temperature in the area of the flame arrester assembly should not exceed 100 °C.
- Pay attention to professional earthing!

### Temperature sensor

- For mounting temperature sensor (17) remove first lock screw (19) and assemble sensor together with a new media resistant gasket and ensure electrical connection with corresponding monitoring device.
- The **release temperature** of the monitoring device should 30 K above the maximum operating temperature.
- Use only the delivered or a temperature sensor with following specification:

	Description
<b>Supplier</b>	Temperaturmeßtechnik Geraberg GmbH
<b>Order number</b>	VH 55.0i201-1014782
<b>Model</b>	PT100
<b>Circuit type</b>	4-wire
<b>Thread connection</b>	G 3/8"

- For assembly and usage of temperature sensor refer to appropriate operating manual.
- The temperature sensor has to be mounted on the unprotected side.
- Usage of other temperature sensor type has to be approved by Flammer GmbH.

## 7. Maintenance

To keep flow resistance at a constantly low level, the in-line detonation flame arrester is to be checked for impurities and, if necessary cleaned, in regular intervals.

### Disassembling

Unscrew the bolts (3, 8) then remove the upper three screws together with spacers (5). The housings (2, 22) could be pushed away from each other with screws (16) by turning the nuts (15).

Use the handle bars (7) for disassembling the flame arrester assembly.

For checking the inner parts first disassemble the counter nut (9) then stabilization bars (11). If O-ring (6) is damaged change it.



- The ribbons of the flame arrester elements (12, 14) could be pushed out when the stabilization bars (11) are disassembled.  
For this reason it is recommended to place it careful on a flat surface.
- The handle bars (7) are only for disassembling. Never use for load pick up.

Petroleum ether is often a suitable cleaning agent, although the instructions of the corresponding safety data sheet in accordance with directive 91/155/EC need to be observed.

### Assembly

After cleaning, reassemble in reverse order.

**Tightening moment of nut M8 (9, 10) : 20 ± 2 Nm**  
**Tightening moment of nut M16 (3, 8) : 140 ± 2 Nm**



- Only use **new** counter nut (9) according ISO 7042 (DIN980) (metallic self locking type) and **new** screw (10) (M8x70 according EN ISO 4017)
- To assure low pressure loss the stabilization bars should be adjusted in-line. Use handle bars (7) for adjusting.
- Clean sealing surfaces before assembly
- Pay attention for the right gap width of the flame arrester element. The gap width (**0.30**) is mentioned on the type label and every flame arrester element.(see fig. above)
- For safety reason it is not permitted to increase the gaps in the flame arrester elements (e.g. to drill).
- After assembly in-line detonation flame arrester and connections have to be tested for leak tightness. (Maximum test pressure  $p_e = 12$  bar).
- Tighten screws with the required tightening moment after 15 minutes again when using PTFE O-rings.

### **After a Detonation:**

- All parts (inside and outside) has to be examined and if necessary exchanged.
- In any case, flame arrester element (12, 14) should be replaced.
- Only use original spare parts from company Flammer GmbH.

### **8. Spare parts**

For ordering spare parts please declare:

- Type of product
- Complete serial number
- Spare part no. (Please refer to **fig. 1** for items)


Item	Product	Spare part no.
6, 9, 10, 11, 12, 13, 14	Spare part set	8001-0044
6	O-ring	

### **9. Technical Consultations**

**Flammer GmbH**  
**Daimlerstr. 3**  
**D-74389 Cleebronn**

**Tel.** : ++49 / (0) 7135 / 93 84 21 0  
**Fax.** : ++49 / (0) 7135 / 93 84 21 99  
**E-mail** : [info@flammergmbh.de](mailto:info@flammergmbh.de)  
**Homepage** : [www.flammergmbh.com](http://www.flammergmbh.com)



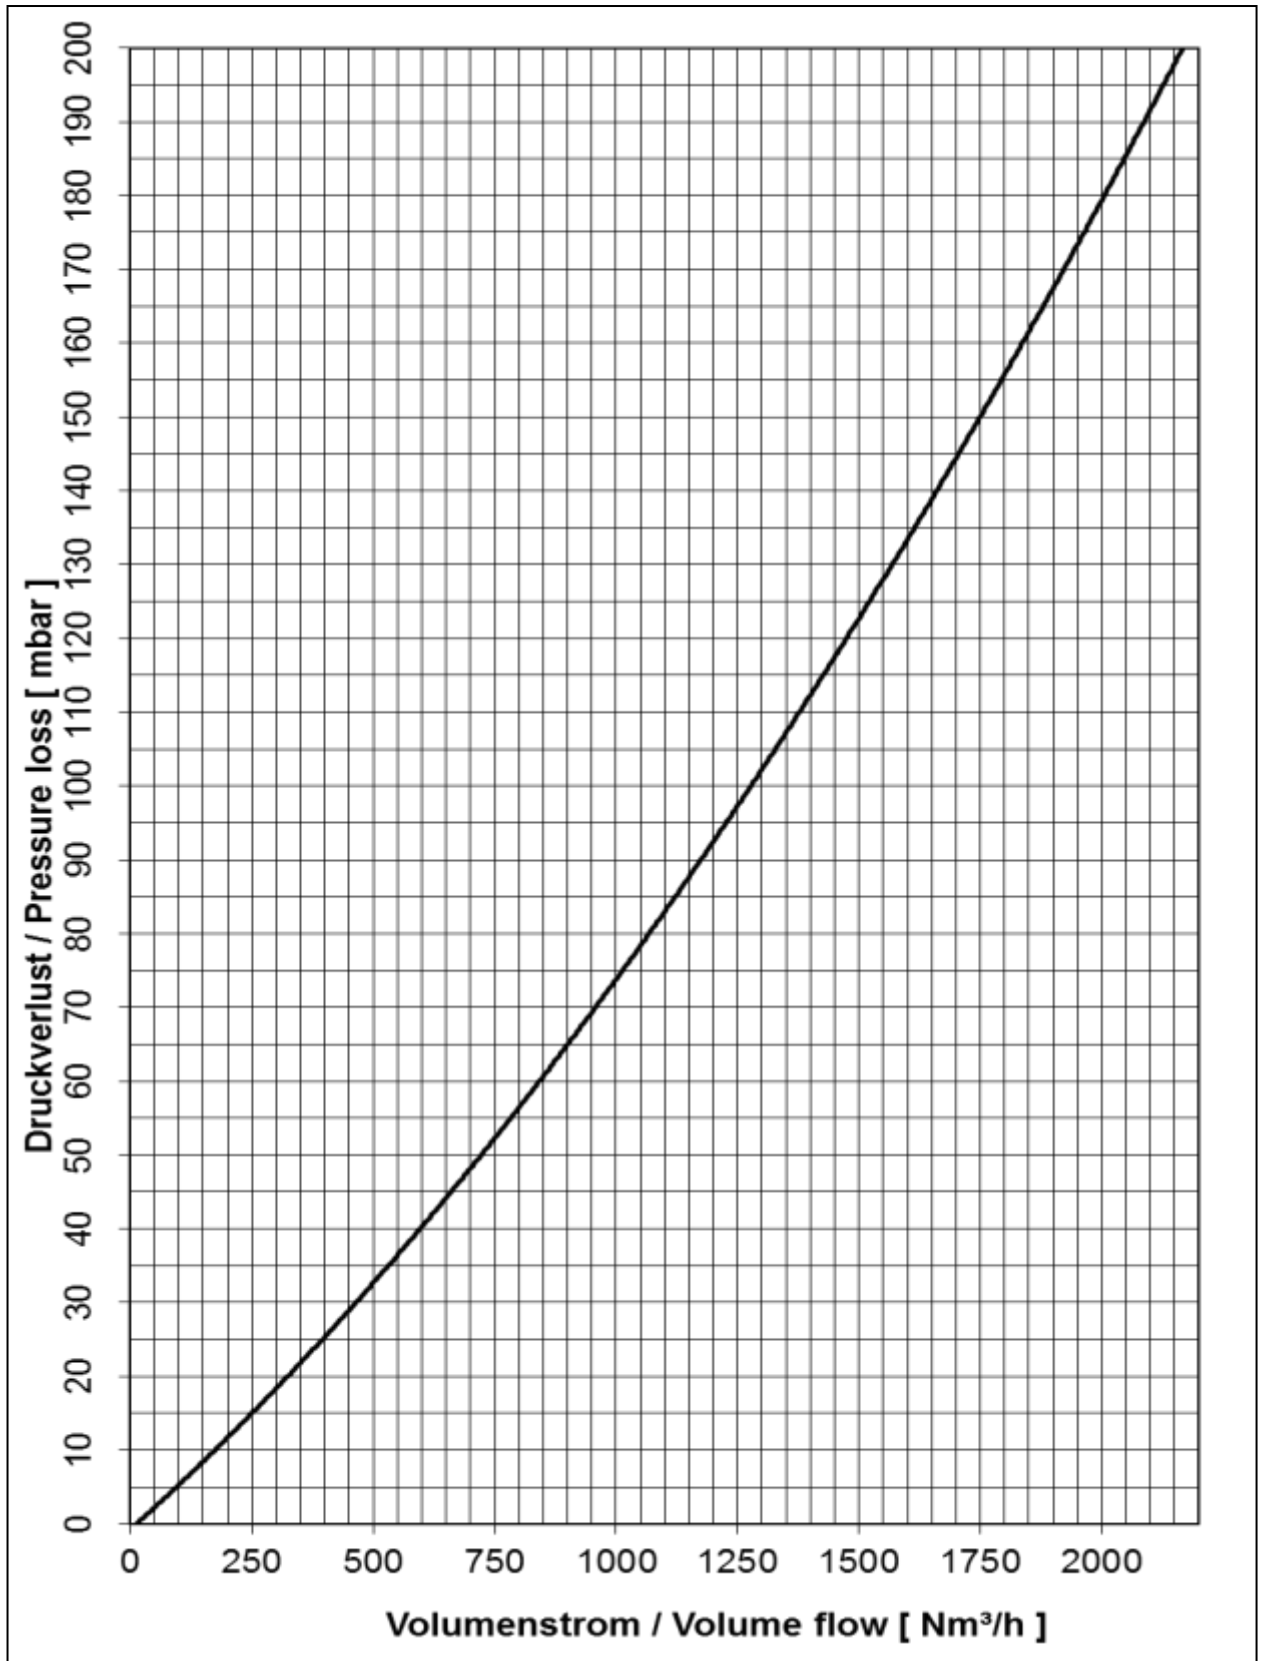

**Fig. 2**

Pressure loss

Medium : Air at  $p_0 = 1013 \text{ mbar}$ ,  $T_0 = 273\text{K}$ , density =  $1,293 \text{ kg/m}^3$