


Operating Instruction
Inline Deflagration Flame Arrester 1013-0012
(Suitable for endurance burning)

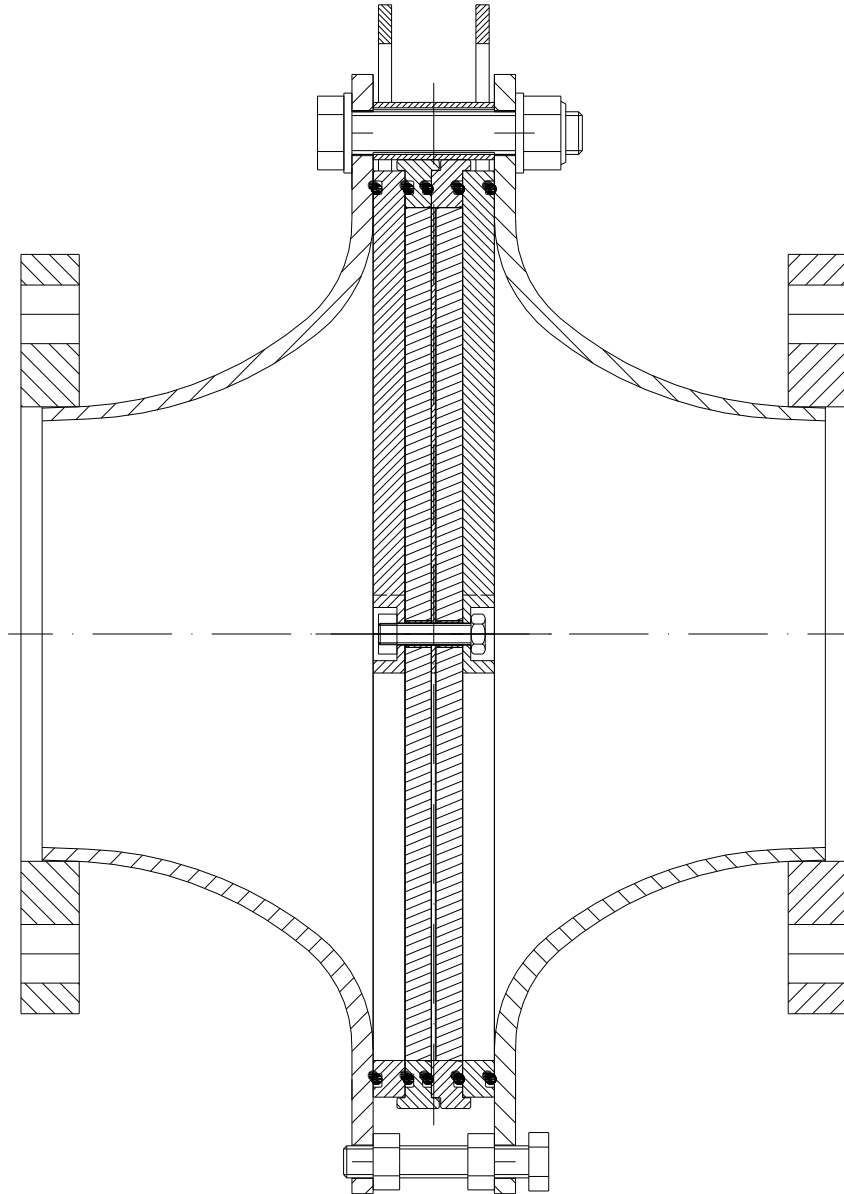

IBExU 12 ATEX 2065 X

 G IIA1

 ⁰¹⁰²

1. Preface

This operating instruction apply to in-line deflagration flame arrester 1013-0012, provided the fact that your in-line deflagration flame arrester meets all technical standards described in this document.

Any information required for the assembly, use and maintenance of the protective system may be obtained from these instructions.

Please read the operating instructions on hand carefully to ensure the safe use of this in-line deflagration flame arrester.

All assembly and maintenance work needs to be carried out by qualified staff.

Information provided in this document may be subject to change without prior notice.

This document or individual parts of it may not be multiplied or copied without the written consent of Flammer GmbH, irrespective of its purpose.

© 2022 by Flammer GmbH. All rights reserved.

The trade and/or used name designations, trademarks, etc., even when not specially marked, do not justify the assumption that they may be considered as fair use, as defined by trademark protection laws.

These operating instructions correspond to the current technical state of in-line deflagration flame arrester 1013-0012. Changes and errors excepted.

In case of dispute, the German text shall prevail.

2. Symbols



Take note of the accompanying documents!
Important instructions for safe usage

3. Safety regulations and safety instructions

3.1 Safety regulations

The following regulations and guidelines are to be observed for the use of this protective system:

- EC type examination number IBExU 12 ATEX 2065 X
- EN ISO 16852 Flame arresters
- European Directive 2014/34/EU
- National safety regulations
- National workers' protection regulations

3.2 Safety instructions

The following instructions are to be observed to guarantee workers protection and occupational safety:

- Safety regulations in compliance with section 3.1
- Observation of laws and provisions in force at the place of application.
Operators and supervising staff are responsible for the fact that these provisions are observed.
- Assembly and maintenance work is to be carried out by qualified staff.

4. Purpose of use

In-line deflagration flame arrester type 1013-0012 prevents light-back at deflagration and endurance burning of potentially explosive vapour-air, and or gas-air mixtures of explosives group IIA1 (MESG ≥ 1.14 mm) at an absolute working pressure of pabs ≤ 1.10 bar in an ignition source preceding pipe with a maximum nominal diameter of DN = 150 mm and a corresponding maximum length of L = 7500 mm.



Warning!

Flame arresters are limited in mounting and use.

Pay attention to the following hints according to EN ISO 16852

Type	DEF		Deflagration flame arrester
Lu/D	50		Explanation see chapter 4.1
BC	a		Suitable for endurance burning
EX	G IIA1		Explosion group
To	60	[°C]	Maximum operating temperature
po	1.10	[bar]	Maximum absolute operating pressure

4.1 Special requirements for safe usage

- Max. nominal pipe diameter DN between the possible ignition source and the deflagration flame arrester : 150 mm
- Max. pipe length L (incl. connecting pieces) between the possible ignition source and the in-line deflagration flame arrester. : 50*DN

Example:

The allowed maximum pipe length is $L = 50 * DN = 6250$ mm for a connected nominal pipe diameter of DN = 125 mm

- The nominal pipe diameter on the unprotected side shall be no larger than the flame arrester connection. The nominal pipe diameter on the protected side shall be no less than the pipe diameter on the unprotected side.
- The Inline deflagration flame arrester may only be used, if the materials resist against the mechanical and/or chemical influences under the actual operating conditions, in such a way, that explosion protection is always guaranteed. This applies particularly to the flame arrester elements whose protection against flame transmission may be endangered by corrosion among others.
- Pipe branches and valves on the unprotected side shall be installed as close as possible to the in-line deflagration flame arrester.
- The in-line deflagration flame arrester is bi-directional, i.e. that it may be connected to either side of the system.
- Combustible gases and or liquids produced during operation must pertain to **explosives group IIA1 with a standard gap (MESG) ≥ 1.14 mm.**
- Shut off valves before and after the flame arrester has to be fully open during normal operation.
- The inline deflagration flame arrester is **tested and authorised for endurance burning.**



Note!

- The safety against endurance burning is ensured at horizontal mounting position. In case of vertical mounting position the unprotected side has to be above.

5. Technical specifications

(See figure 1)

Connection : Flange DN150 EN1092-1 (DIN 2576) PN10 (16) or similar
 Pressure loss : see fig. 2

6. Assembly

(See figure 1)

The inline deflagration flame arrester is to be fully and stressless joined to the respective connecting parts.



- Note requirements of chapter 4.
- The internal diameters of the connecting parts have to meet the connected pipe size.
- Any connection is to be sufficiently sealed with suitable media resistant sealing and checked for leakage. (Maximum test pressure $p_e = 12$ bar).
- Pay attention to professional earthing!
- Due to possible bimetallic corrosion (contact corrosion), we advise against use galvanized steel fittings in connection with stainless steel installations.

7. Maintenance

To keep flow resistance at a constantly low level, the inline deflagration flame arrester is to be checked for impurities and, if necessary cleaned, in regular intervals.

Disassembling

Loose the 8 bolts (Pos.3, 8) then remove the upper 3 bolts, nuts and spacers (Pos.5). The two housings (Pos.2) could be pushed away from each other with screws (Pos.16) by turning the nuts (Pos.15).

Use the handle bars (Pos.7) for drawing out the complete flame arrester assembly. (Pos.9, 10, 11, 12, 13, 14)

It is recommended to clean the whole assembly to prevent damage.

If O-ring (Pos.6) is damaged change it.

For checking the inner O-rings first remove the counter nut (Pos.9) then disassemble stabilization bar (Pos.11) and flame arrester elements (Pos.12, 14).



- The ribbons of the flame arrester element (Pos.12, 14) could be pushed out when the stabilization bars (Pos.11) are disassembled.
 For this reason it is recommended to place it careful on a flat surface.
- The handle bars (Pos.7) are only for disassembling. Never use for load pick up

Petroleum ether is often a suitable cleaning agent, although the instructions of the corresponding safety data sheet in accordance with directive 91/155/EC need to be observed.

Assembly

After cleaning, reassemble in reverse order.

Tightening moment of nut M8 (pos. 9, 10) : 20 ± 2 Nm
Tightening moment of nut M16 (pos. 3, 8) : 140 ± 2 Nm



- Only use **new** counter nut (Pos.9) according ISO 7042 (DIN980) (metallic self locking type) and **new** screw (Pos.10) (M8x25 according EN ISO 4017)
- To assure low pressure loss the stabilization bars should be adjusted in line. Use handle bars (7) for adjusting.
- Clean sealing surfaces before assembly
- Pay attention for the right gap width of the flame arrester element. The gap width (**Δ0,50**) is mentioned on the type label and every flame arrester element.(see fig. above)
- For safety reason it is not permitted to increase the gaps in the flame arrester elements (e.g. to drill).
- After assembly inline deflagration flame arrester and connections have to be tested for leak tightness. (Maximum test pressure $p_e = 12$ bar).
- Tighten screws with the required tightening moment after 12 minutes again when using PTFE O-rings.

After a deflagration:

- All parts (inside and outside) has to be examined and if necessary exchanged.
- In any case, flame arrester element (Pos.12, 14) should be replaced.

After endurance burning:

- Inline deflagration flame arrester has to be exchanged by a new one!

8. Spare parts

For ordering spare parts please declare:

- Type of product
- Complete serial number
- Spare part no. (Please refer to **fig. 1** for items)

Item	Product	Spare part no.
6, 9, 10, 11, 12, 13, 14	Spare part set	8001-0040
6	O-Ring	

9. Technical Consultations

Flammer GmbH
Daimlerstr. 3
D-74389 Cleebronn

Tel. : ++49 / (0) 7135 / 93 84 21 0
Fax. : ++49 / (0) 7135 / 93 84 21 99
E-mail : info@flammergmbh.de
Homepage : www.flammergmbh.com

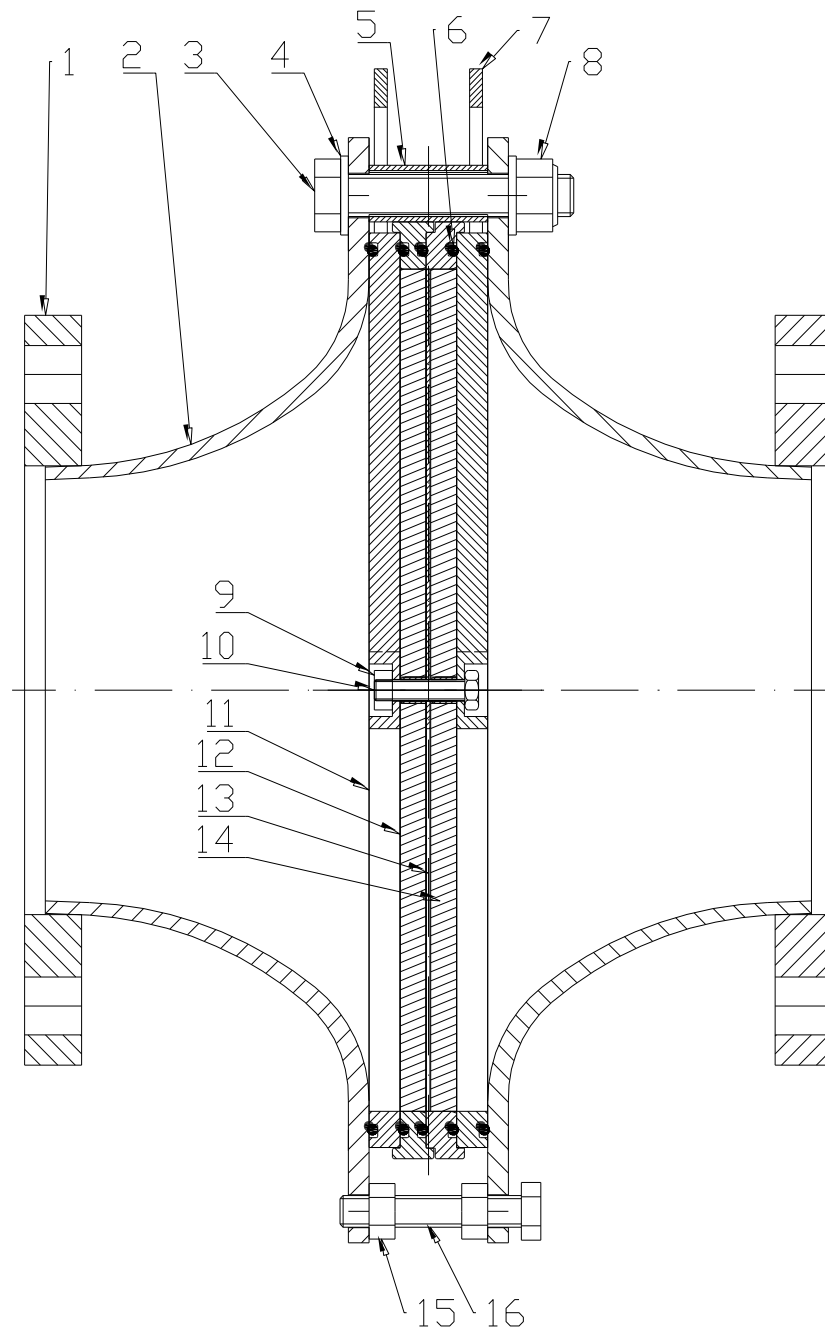


Fig. 1
Construction

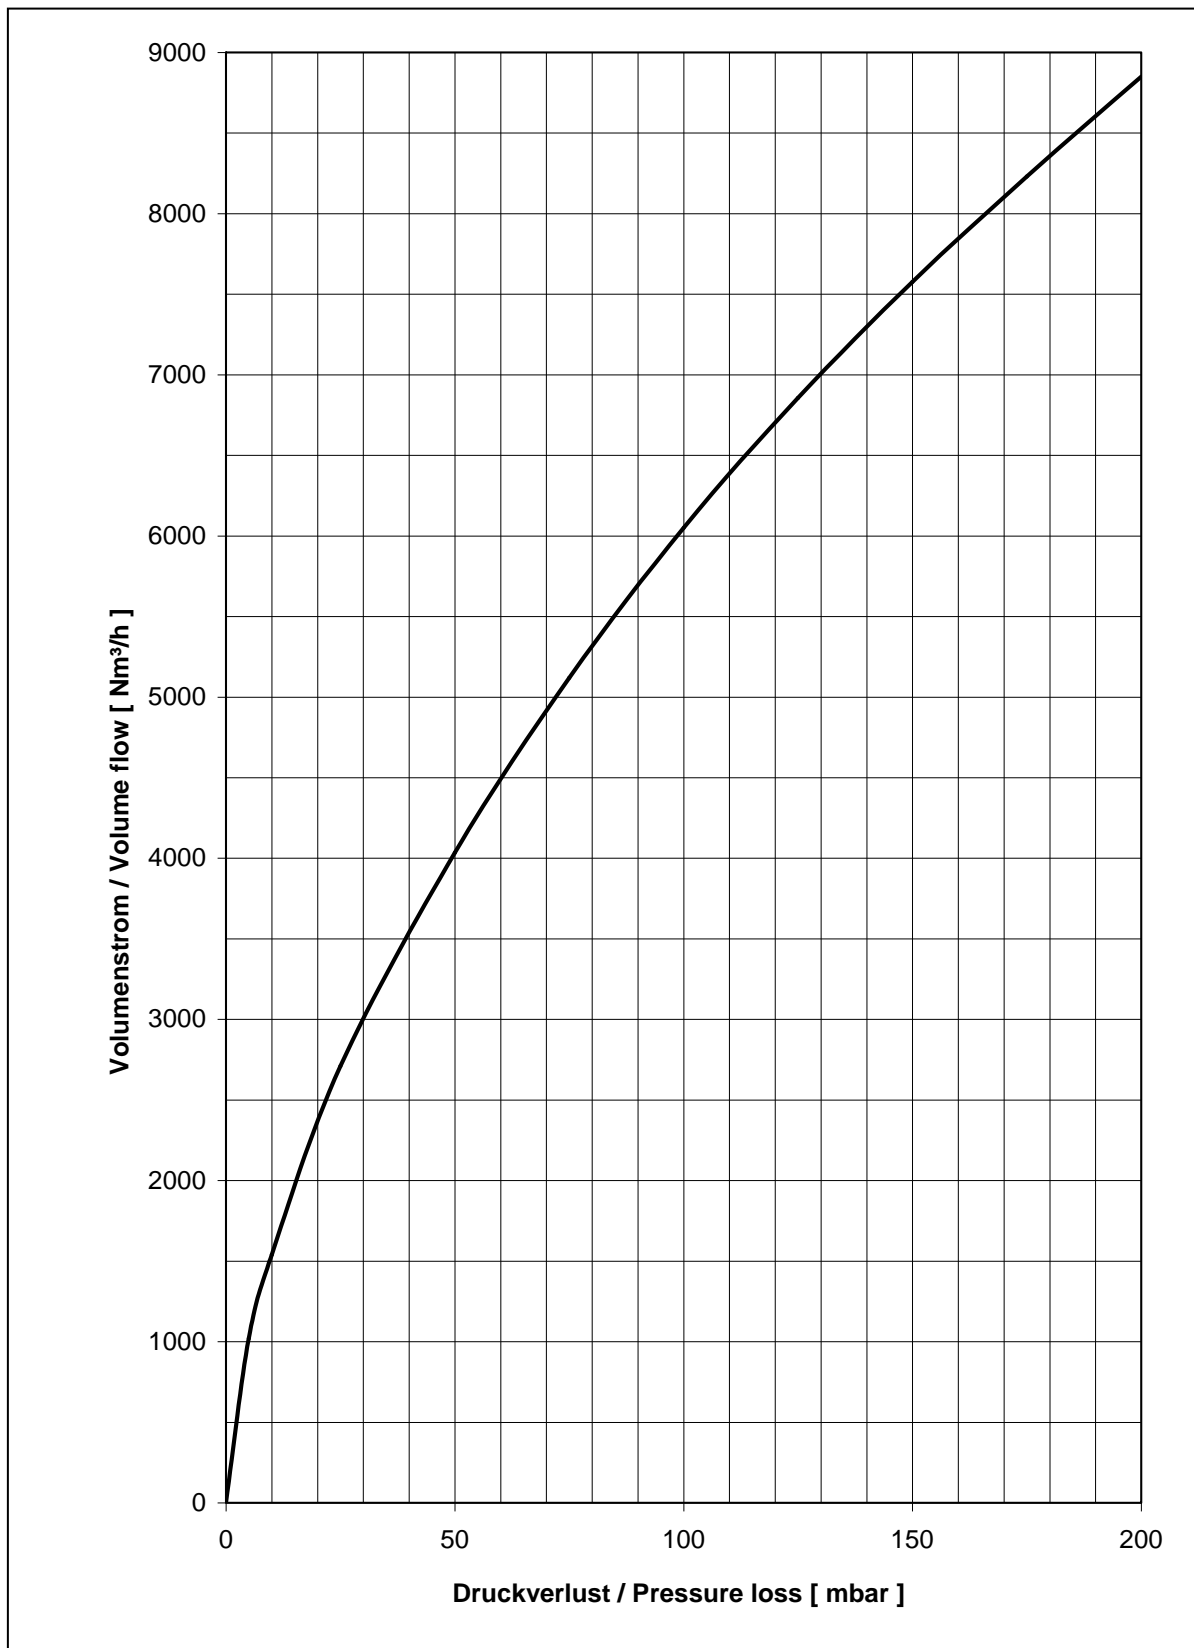


Fig. 2

Pressure loss

Medium : Air at $p_0 = 1013$ mbar, $T_0 = 273K$, density = $1,293$ kg/m³